



Demo ARI Company
Unit 1c, Clapham North Arts
Center, 26-32 Voltaire Rd
London SW4 6DH
United Kingdom

AUTOMIST INSTALLATION AND COMMISSIONING CERTIFICATE #LLFPST

Job Number	LLFPST	Installer Reference	Test Installation
Installation Date	2021-01-13	Installation Type	Elective
Trained Specifier	Joe Smith	Trained Installer	Jamal Gupta
Installation Address	27 London rd, Welling, Kent, DA14 RTJ		

Installation Details

Property Type	Flat	Max. Ceiling Height	2.40
Coverage Area	23.31	Unprotected Area	4.89
Pump Location	Pump Circuit	Pump Serial	Hose Type / Length
Under Sink	Circuit 1 (C16 Dedicated MCB)	8002677	Hose with 1/4" Nominal Diameter / 12.00m
Head Location	Head Type (Serial)	Pressure	Controller Location (Serial / Version)
Lounge	Smartsan Hydra (11007461)	90.00	Next to DB (1002712 / Dec 2020)
Alarm	Alarm Type	Serial	Other Details
1	Wireless Battery	5947	
Purpose of Installation	Compliance		
	Authority Having Jurisdiction	n/a	

Notes and Deviations	This form certifies that the Accredited Installer (detailed above) has: <ol style="list-style-type: none">Successfully commissioned the detailed Automist installation on 2021-01-13Designed and installed in accordance with the latest installation Design, Installation, Operation and Maintenance (DIOM) Manual (accompanied by an attached layout design).
-----------------------------	---


Service Details

Service Contact	Installation Ltd	Submitted By	Joe Smith
Email	j.smith@installationltd.co.uk	Telephone	02083045768
Serviced On	2021-01-13	Service Due	2022-01-13







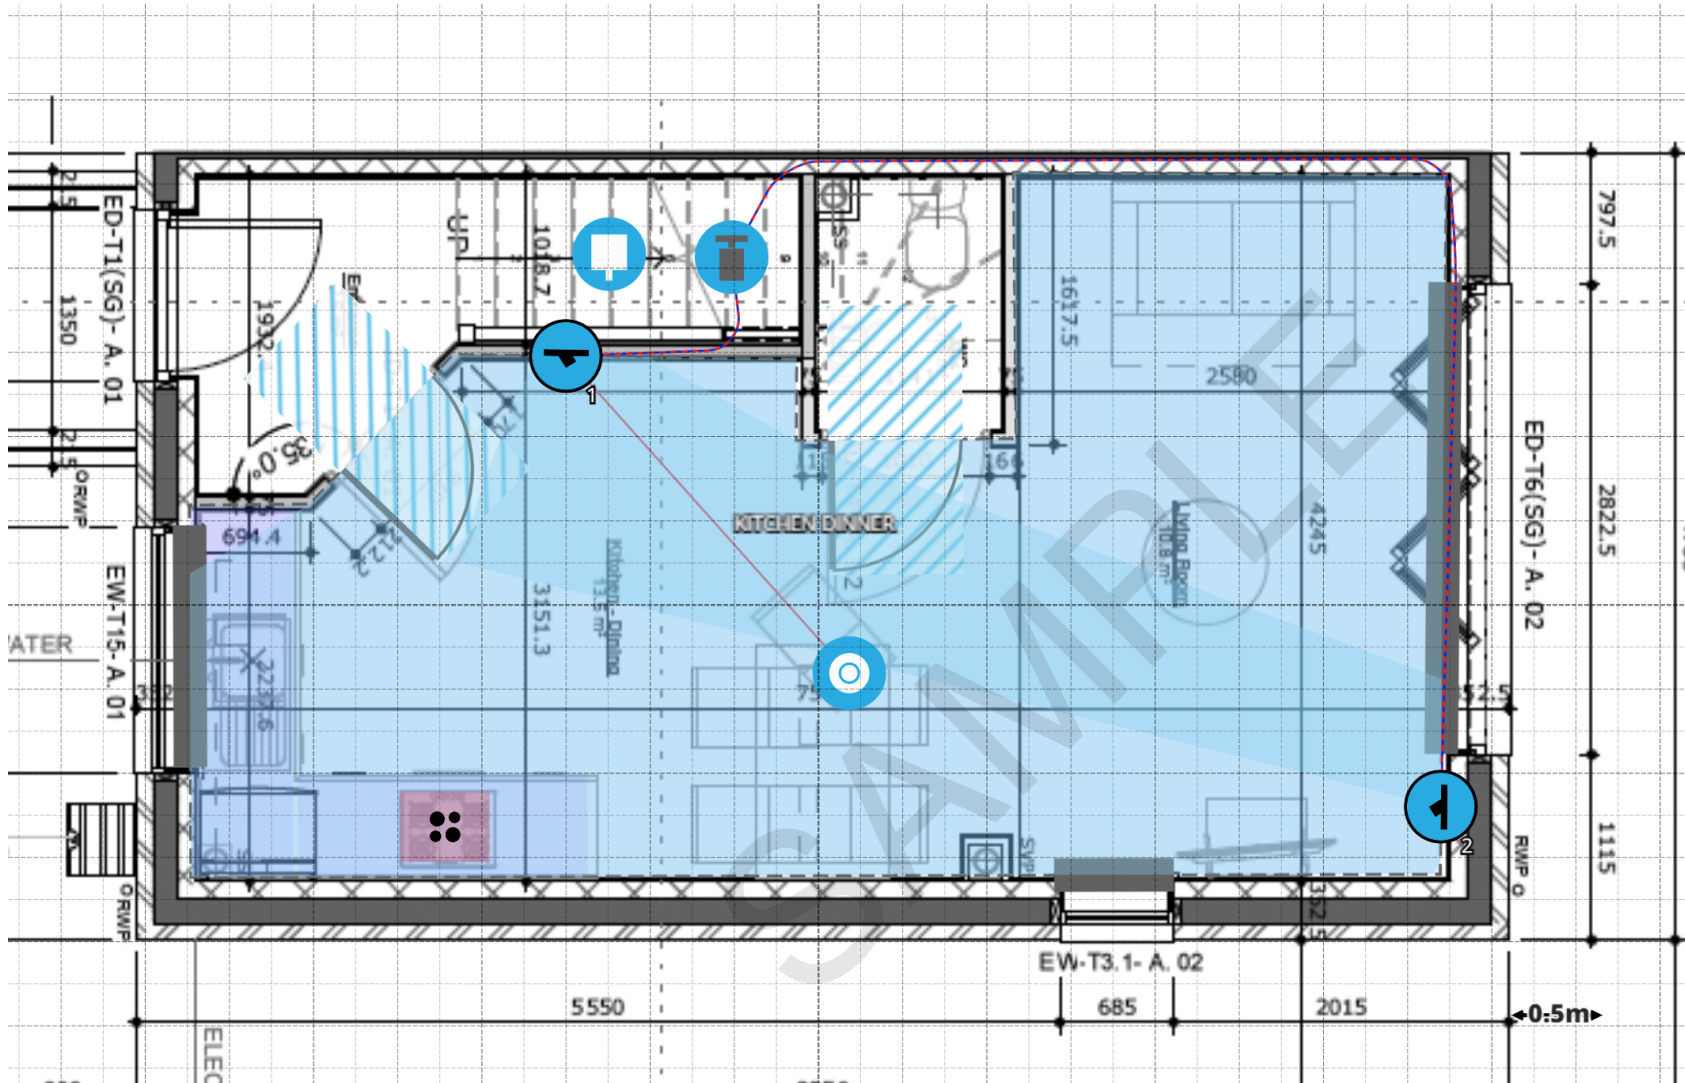








Layout example



ref: 161226145759



SYSTEM INVENTORY

-  DETECTOR (1)
-  PUMP (1)
-  SMARTSCAN (2)
-  FIXED HEAD (0)
-  CONTROLLER (1)
-  HOSE 1/4" (10.05m)
-  HOSE 5/16" (0m)
-  WIRE (12.48m)
-  HOSE & WIRE (10.05m)
-  ZONE TO CONSIDER
-  FIRE HAZARD
-  PROTECTED AREA
-  STERILE AREA
-  DOOR
-  WINDOW

SPECIFIER: Joe Smith
EMAIL: j.smith@insta.co.uk

AREA DETAILS
TOTAL: 22.83m²

NOTES:
Window: Keep 0.3m clearance for curtains.
Objective: Code compliance. Meeting building regulations

ADDRESS: 35 Example Rd City
St Bank London SE9 United Kingdom

SYSTEM DETAILS
PUMP COVERAGE: 22.58m²
UNPROTECTED AREA: 0.25m²